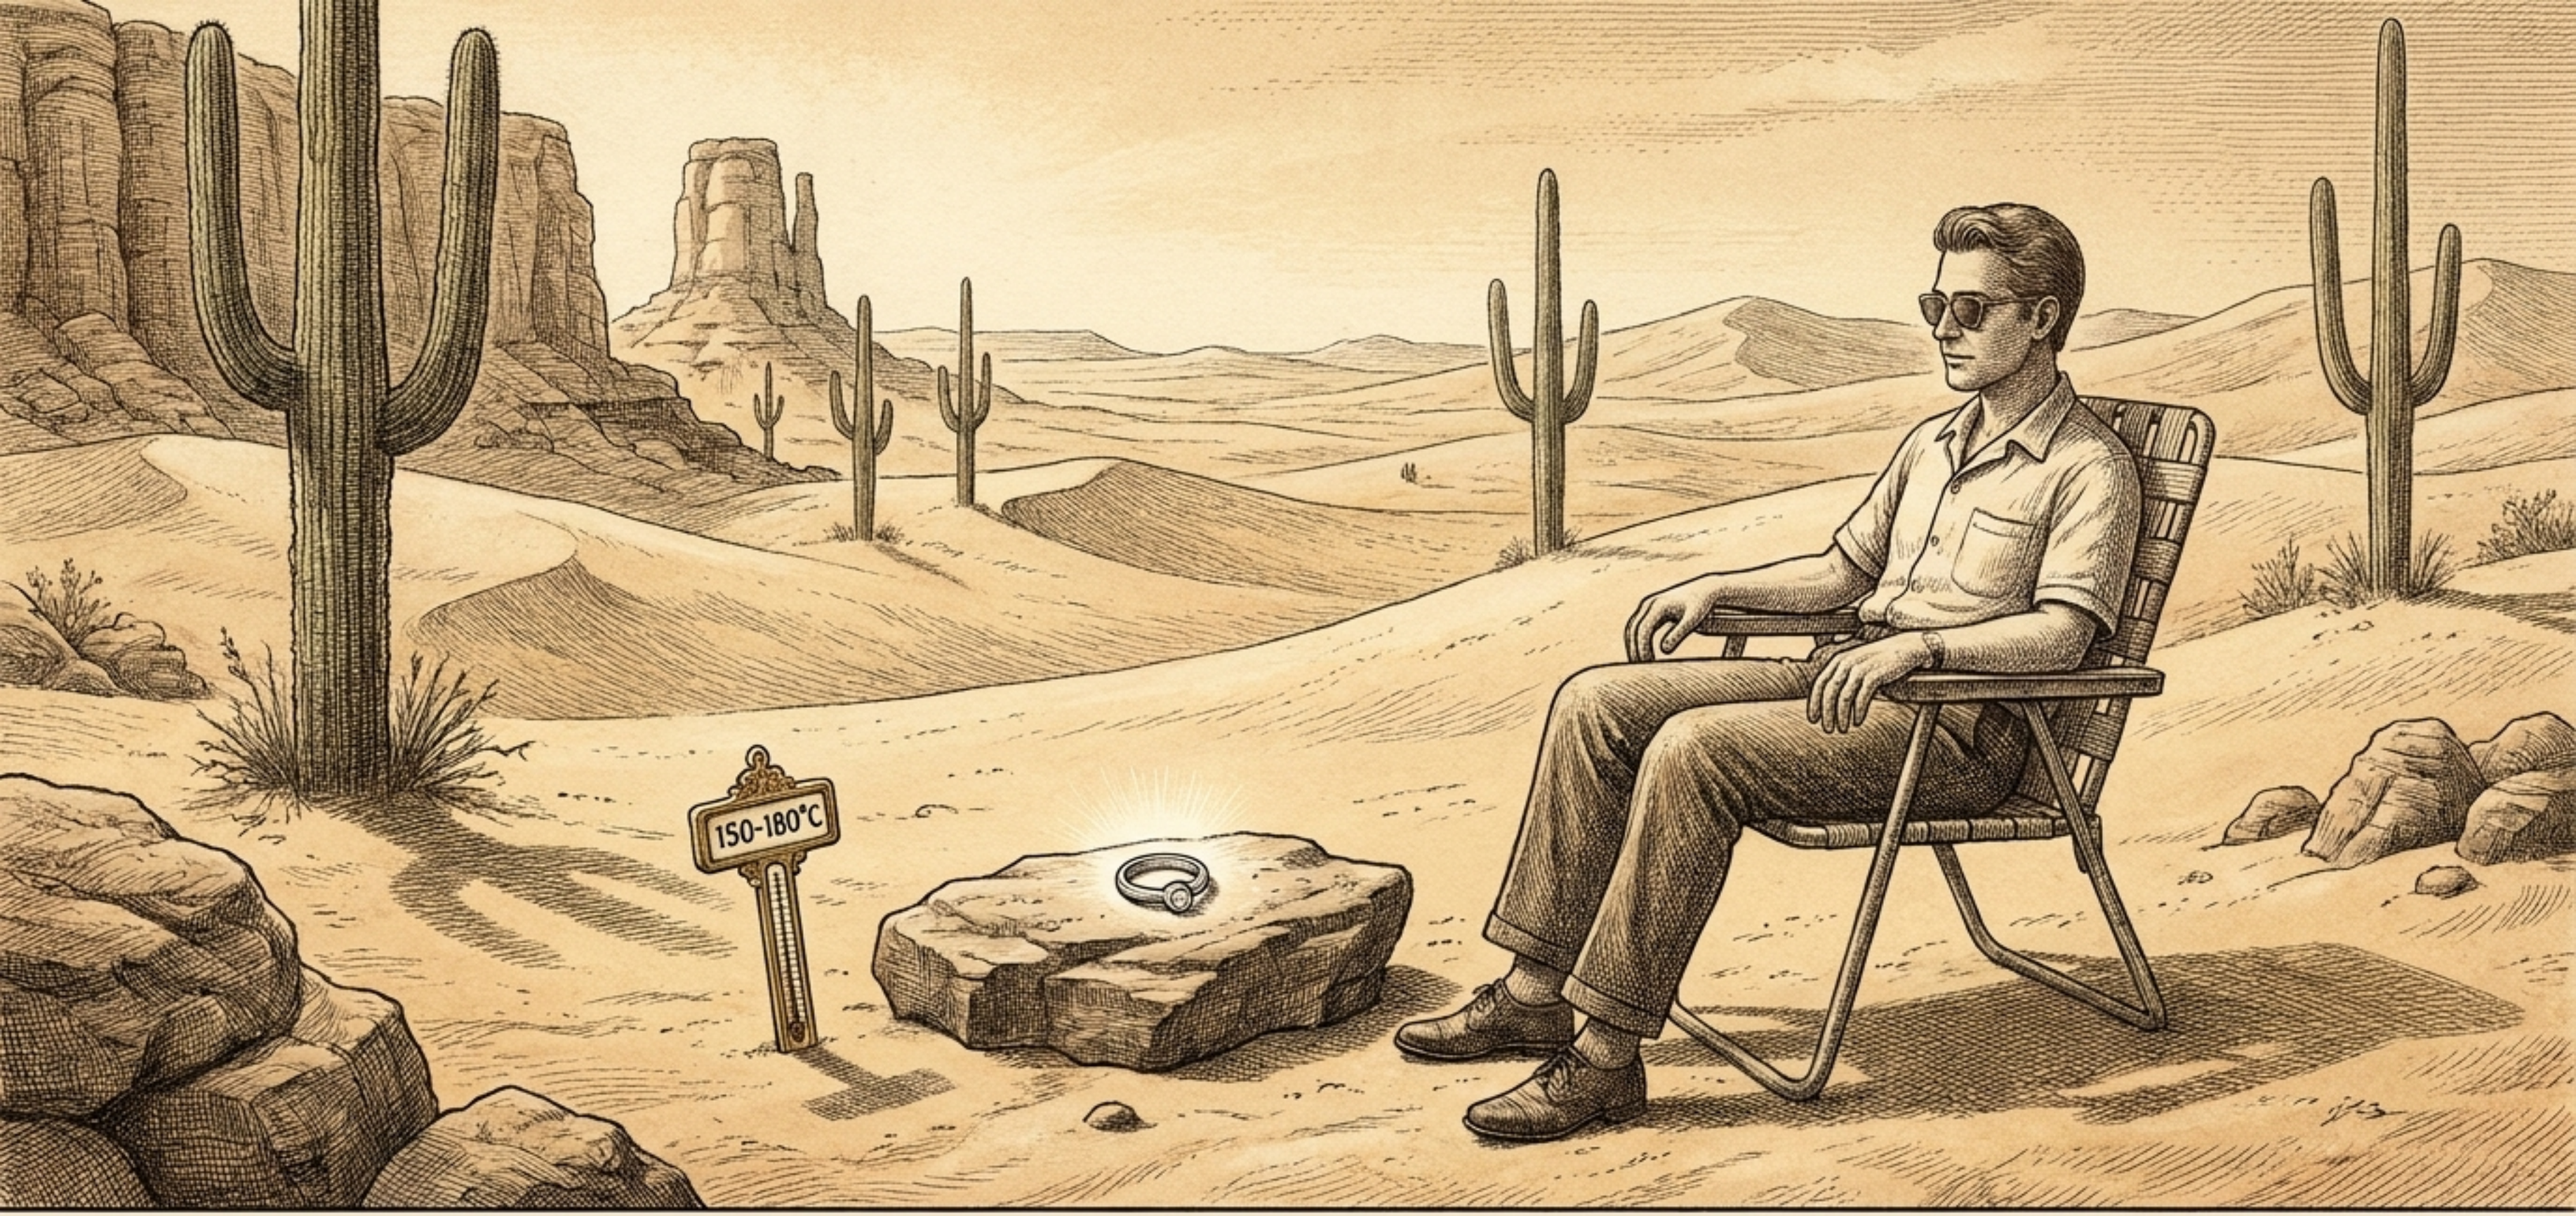


Dry heat sterilization at 150-180°C for 1 hour is acceptable.

The studio electric bill remains a complete mystery.