
	REVISION	
		DATE
REV:	2024.05.22	DATE

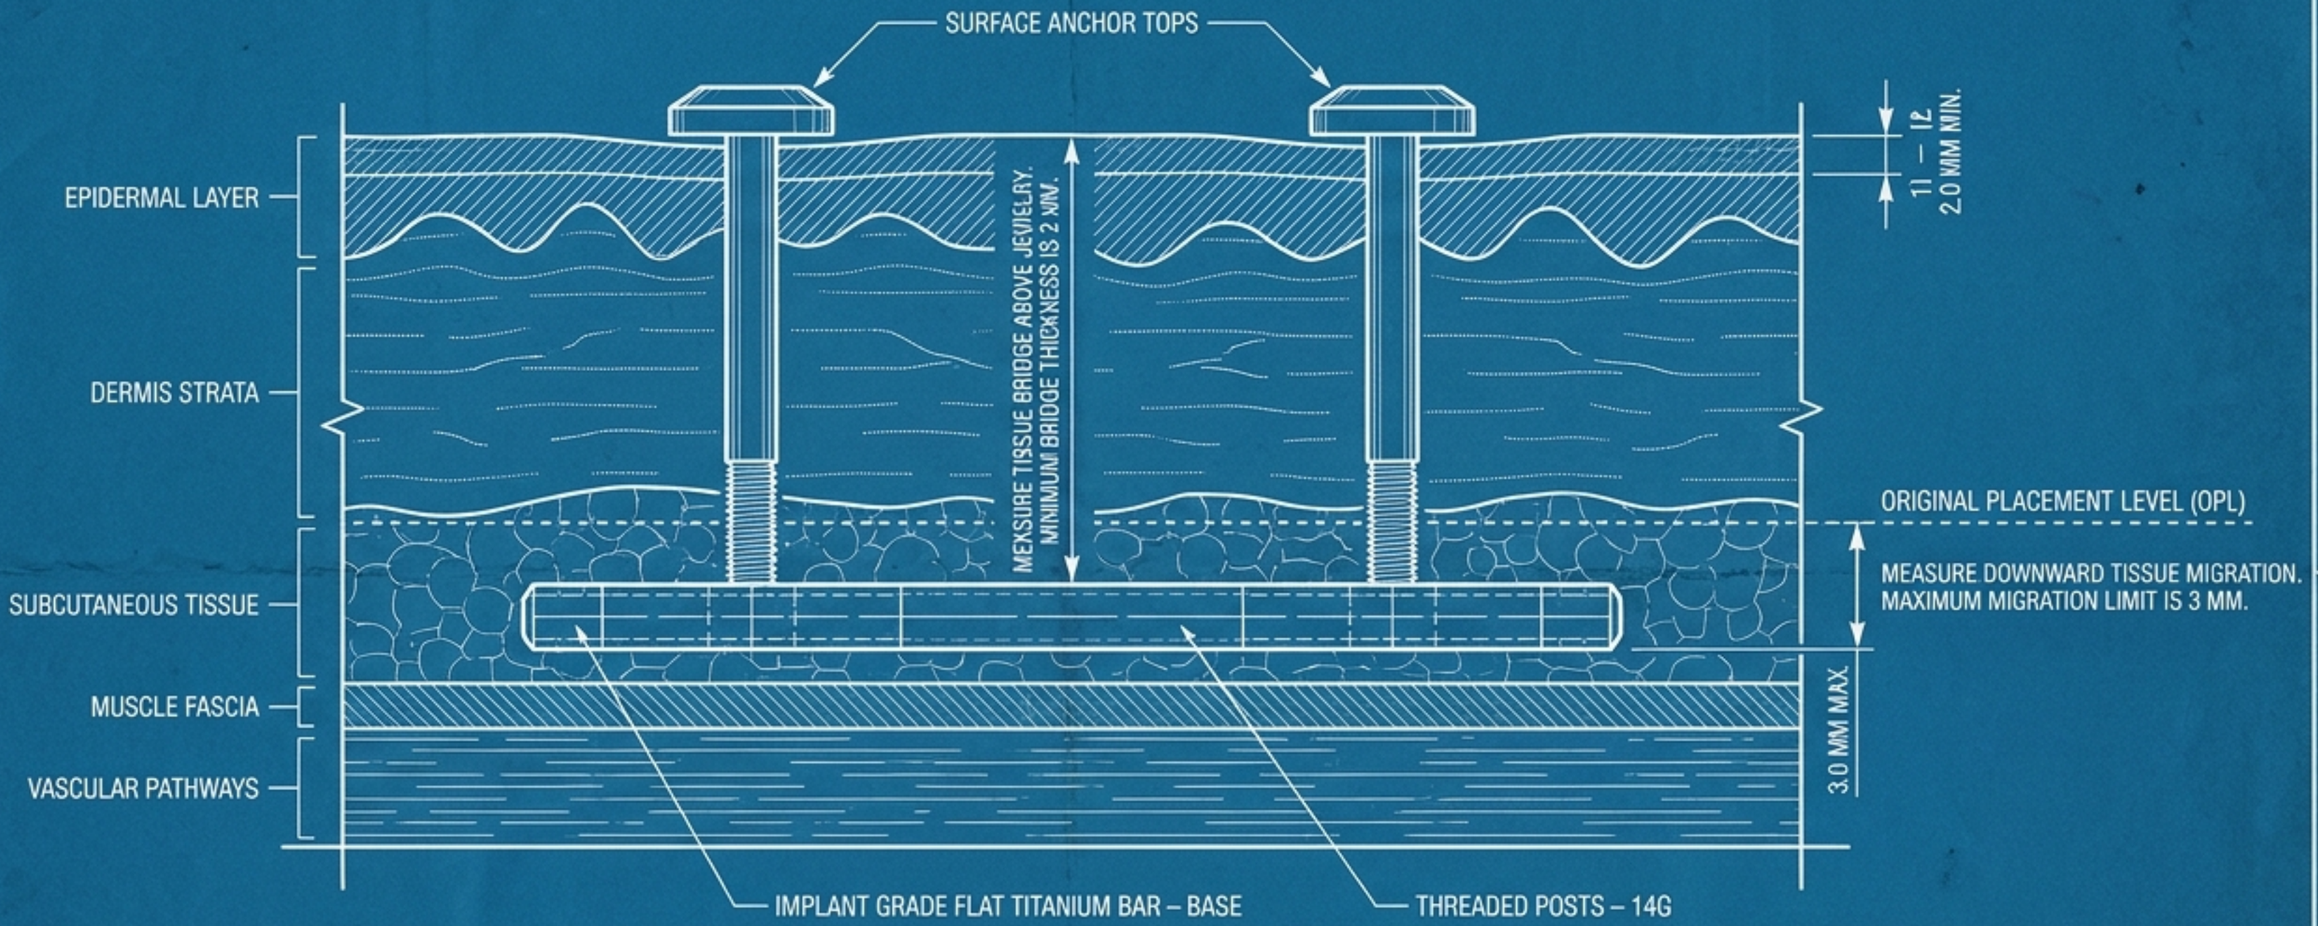

CLINICAL DIRECTIVE PROTOCOL

ENGINEERING TOLERANCE SPECIFICATION

RETIRING A PIERCING IS A CLINICAL DECISION BASED ON TISSUE LIMITS.

REMOVE JEWELRY BEFORE THE FISTULA TEARS.

PROJECT:
HUMAN INTERFACE ARCHITECTURE
SURFACE ANCHOR INTEGRITY ANALYSIS

DWG NO.	REV.
CLIN-BPA-01	A

DATE: 2024.05.22