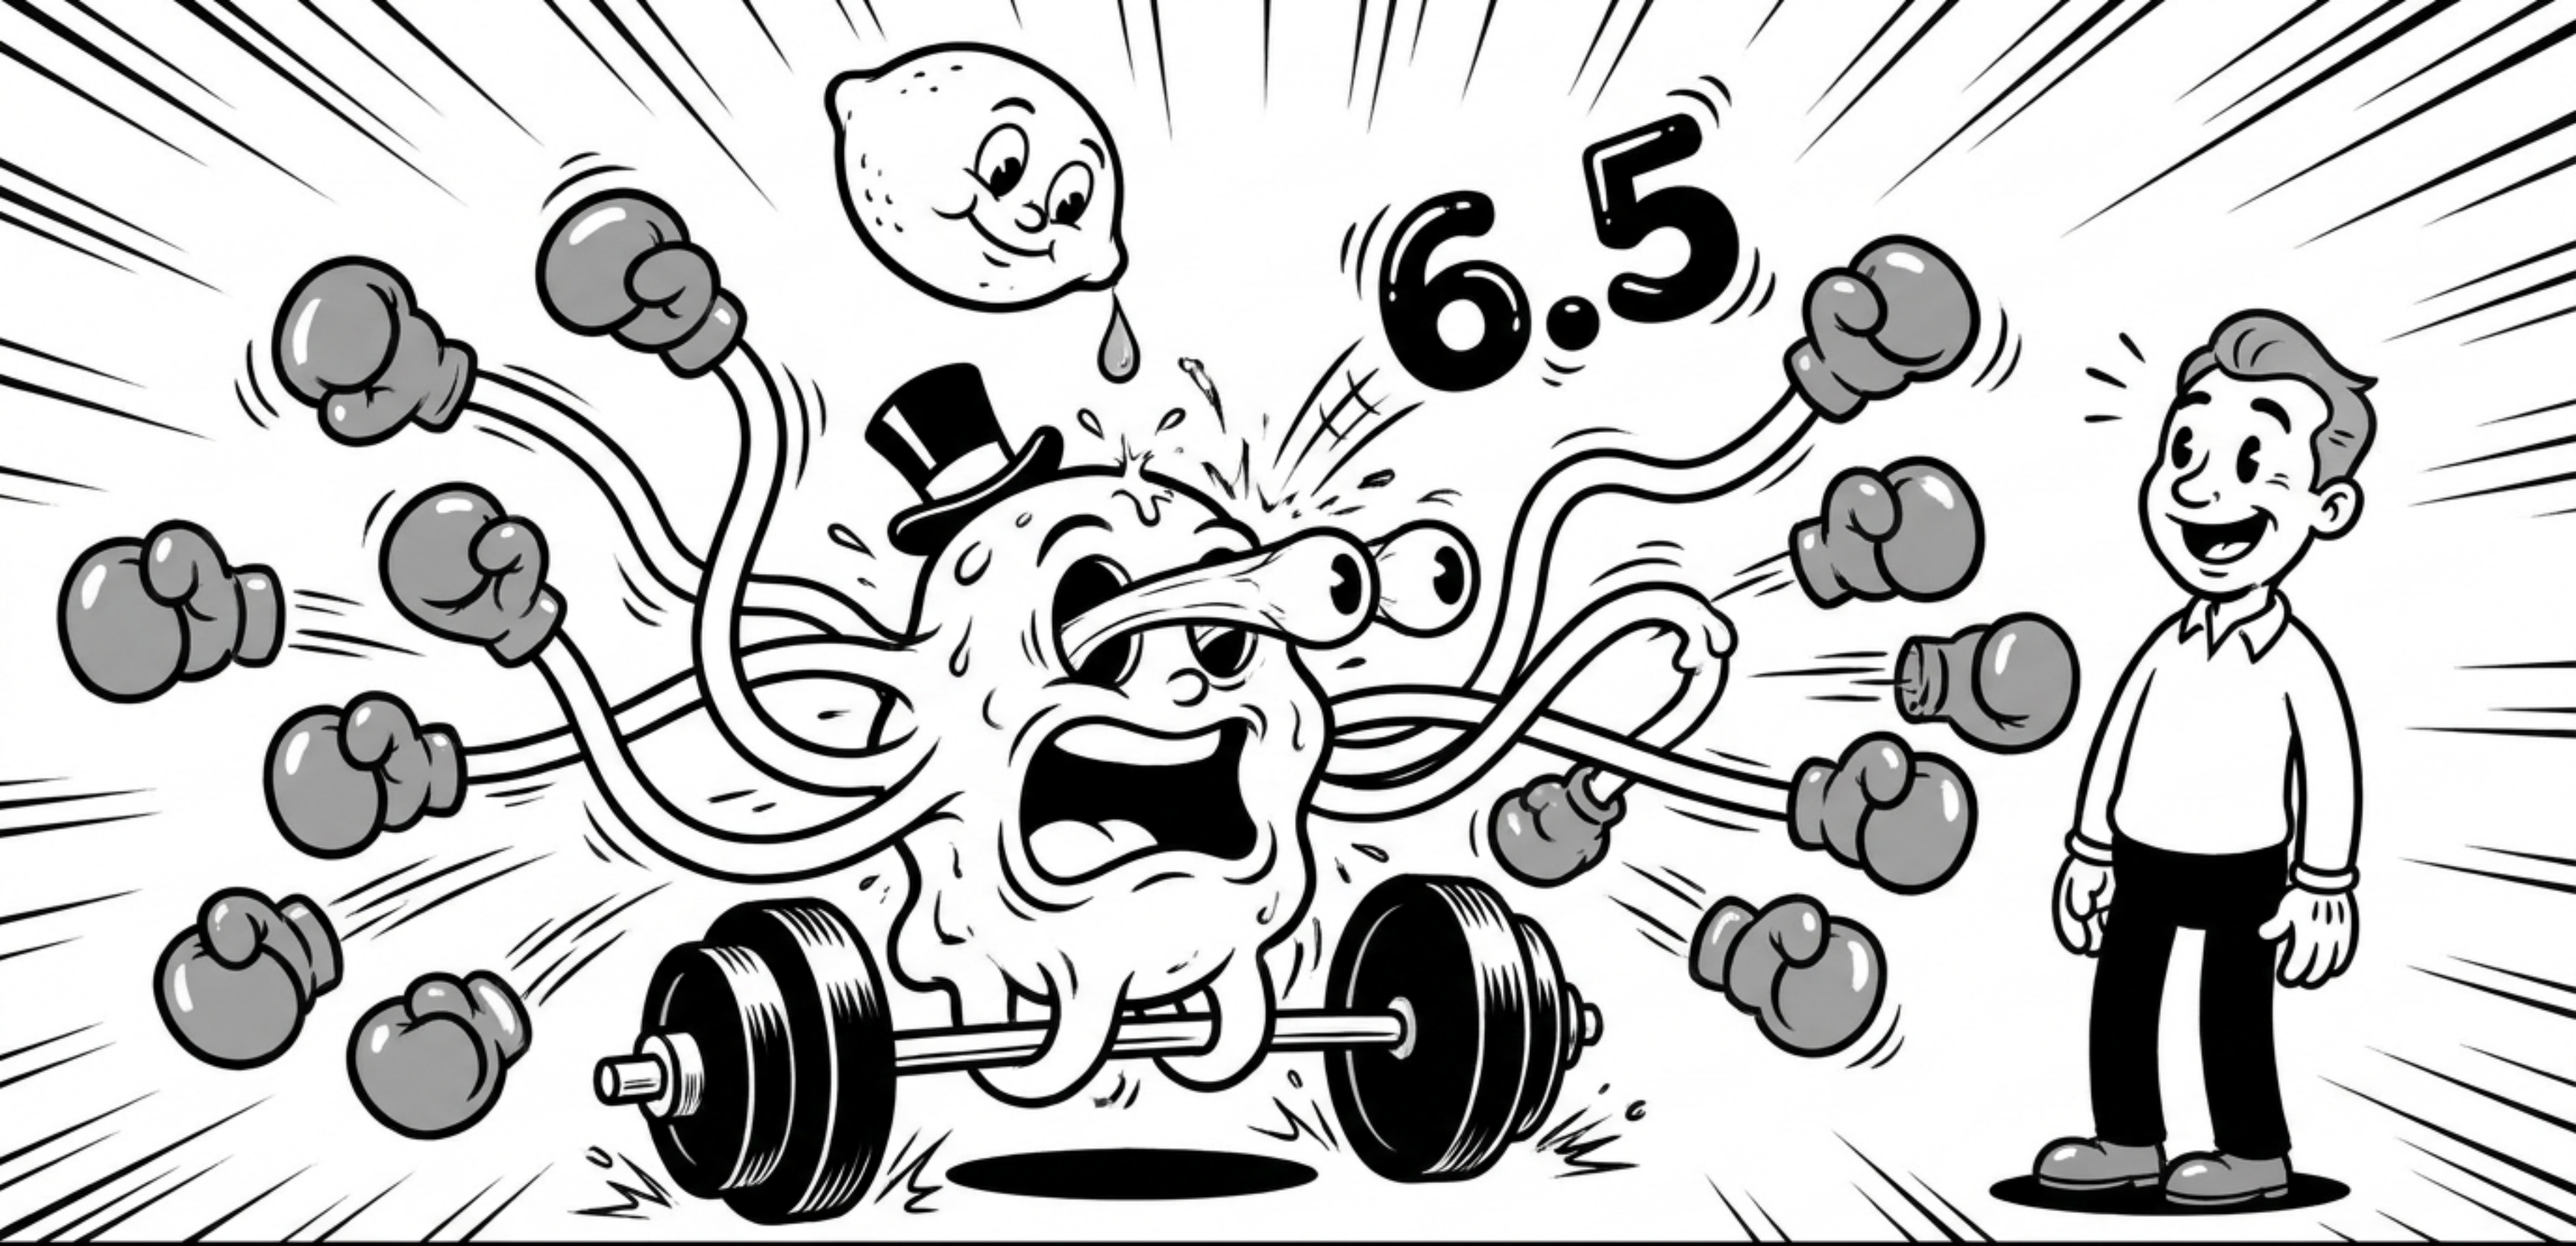


Current PMAA-based systems respond to pH drops below 6.5.

The smart jewelry panics significantly faster than the client.