


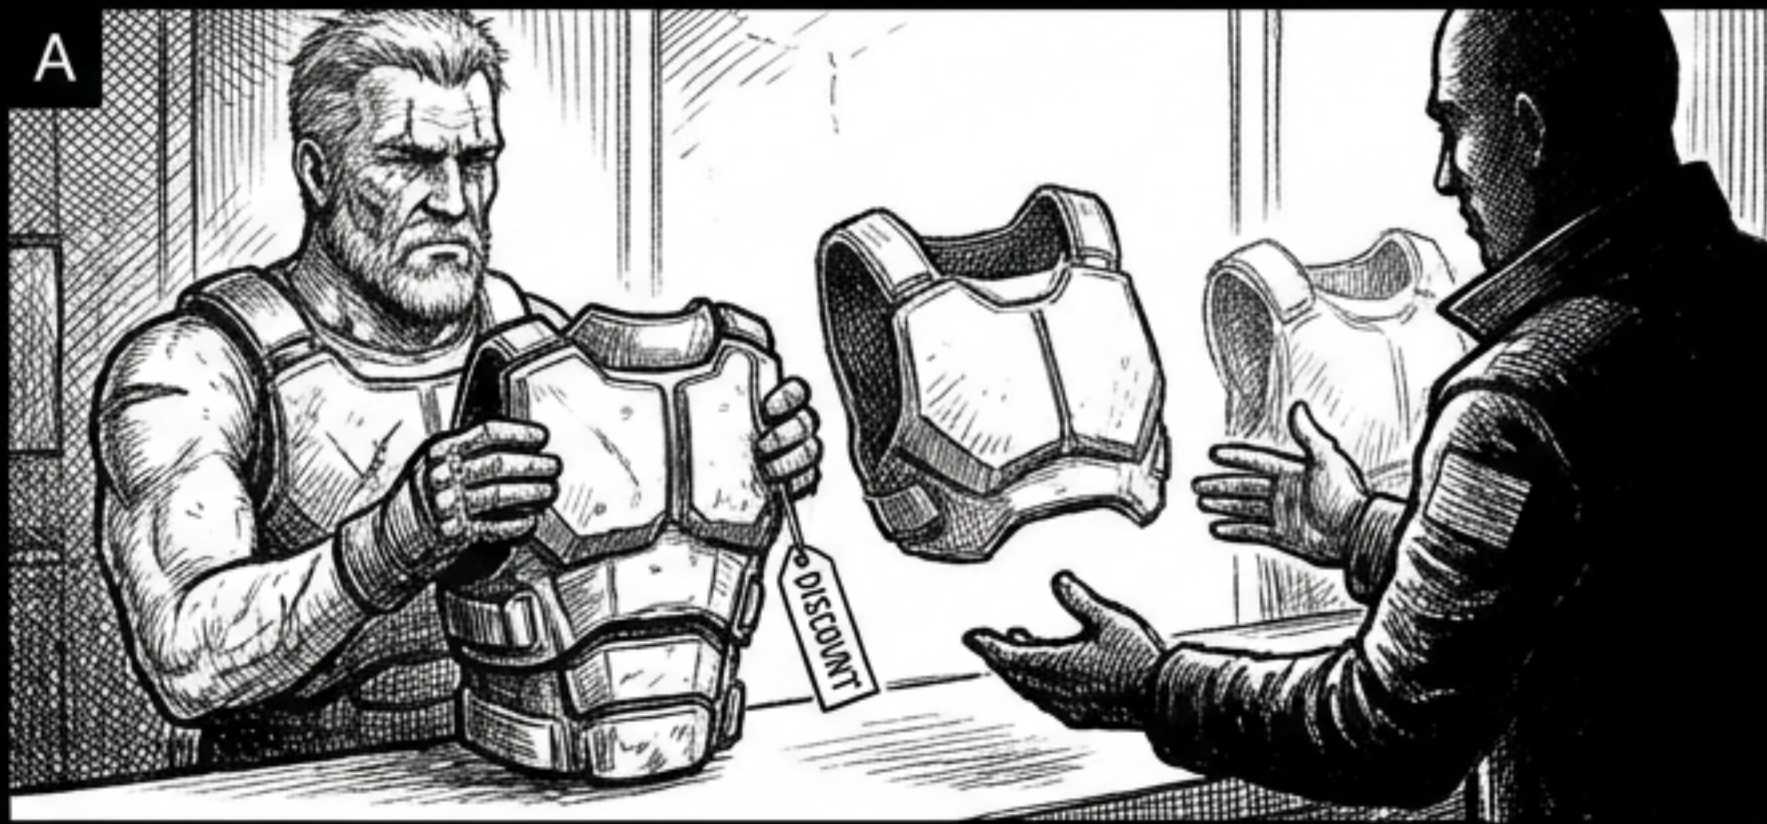

Implant-grade steel keeps its nickel locked in the crystal structure while cheap steel releases it into the wound.

The structural integrity of wet paper is rarely desirable.