


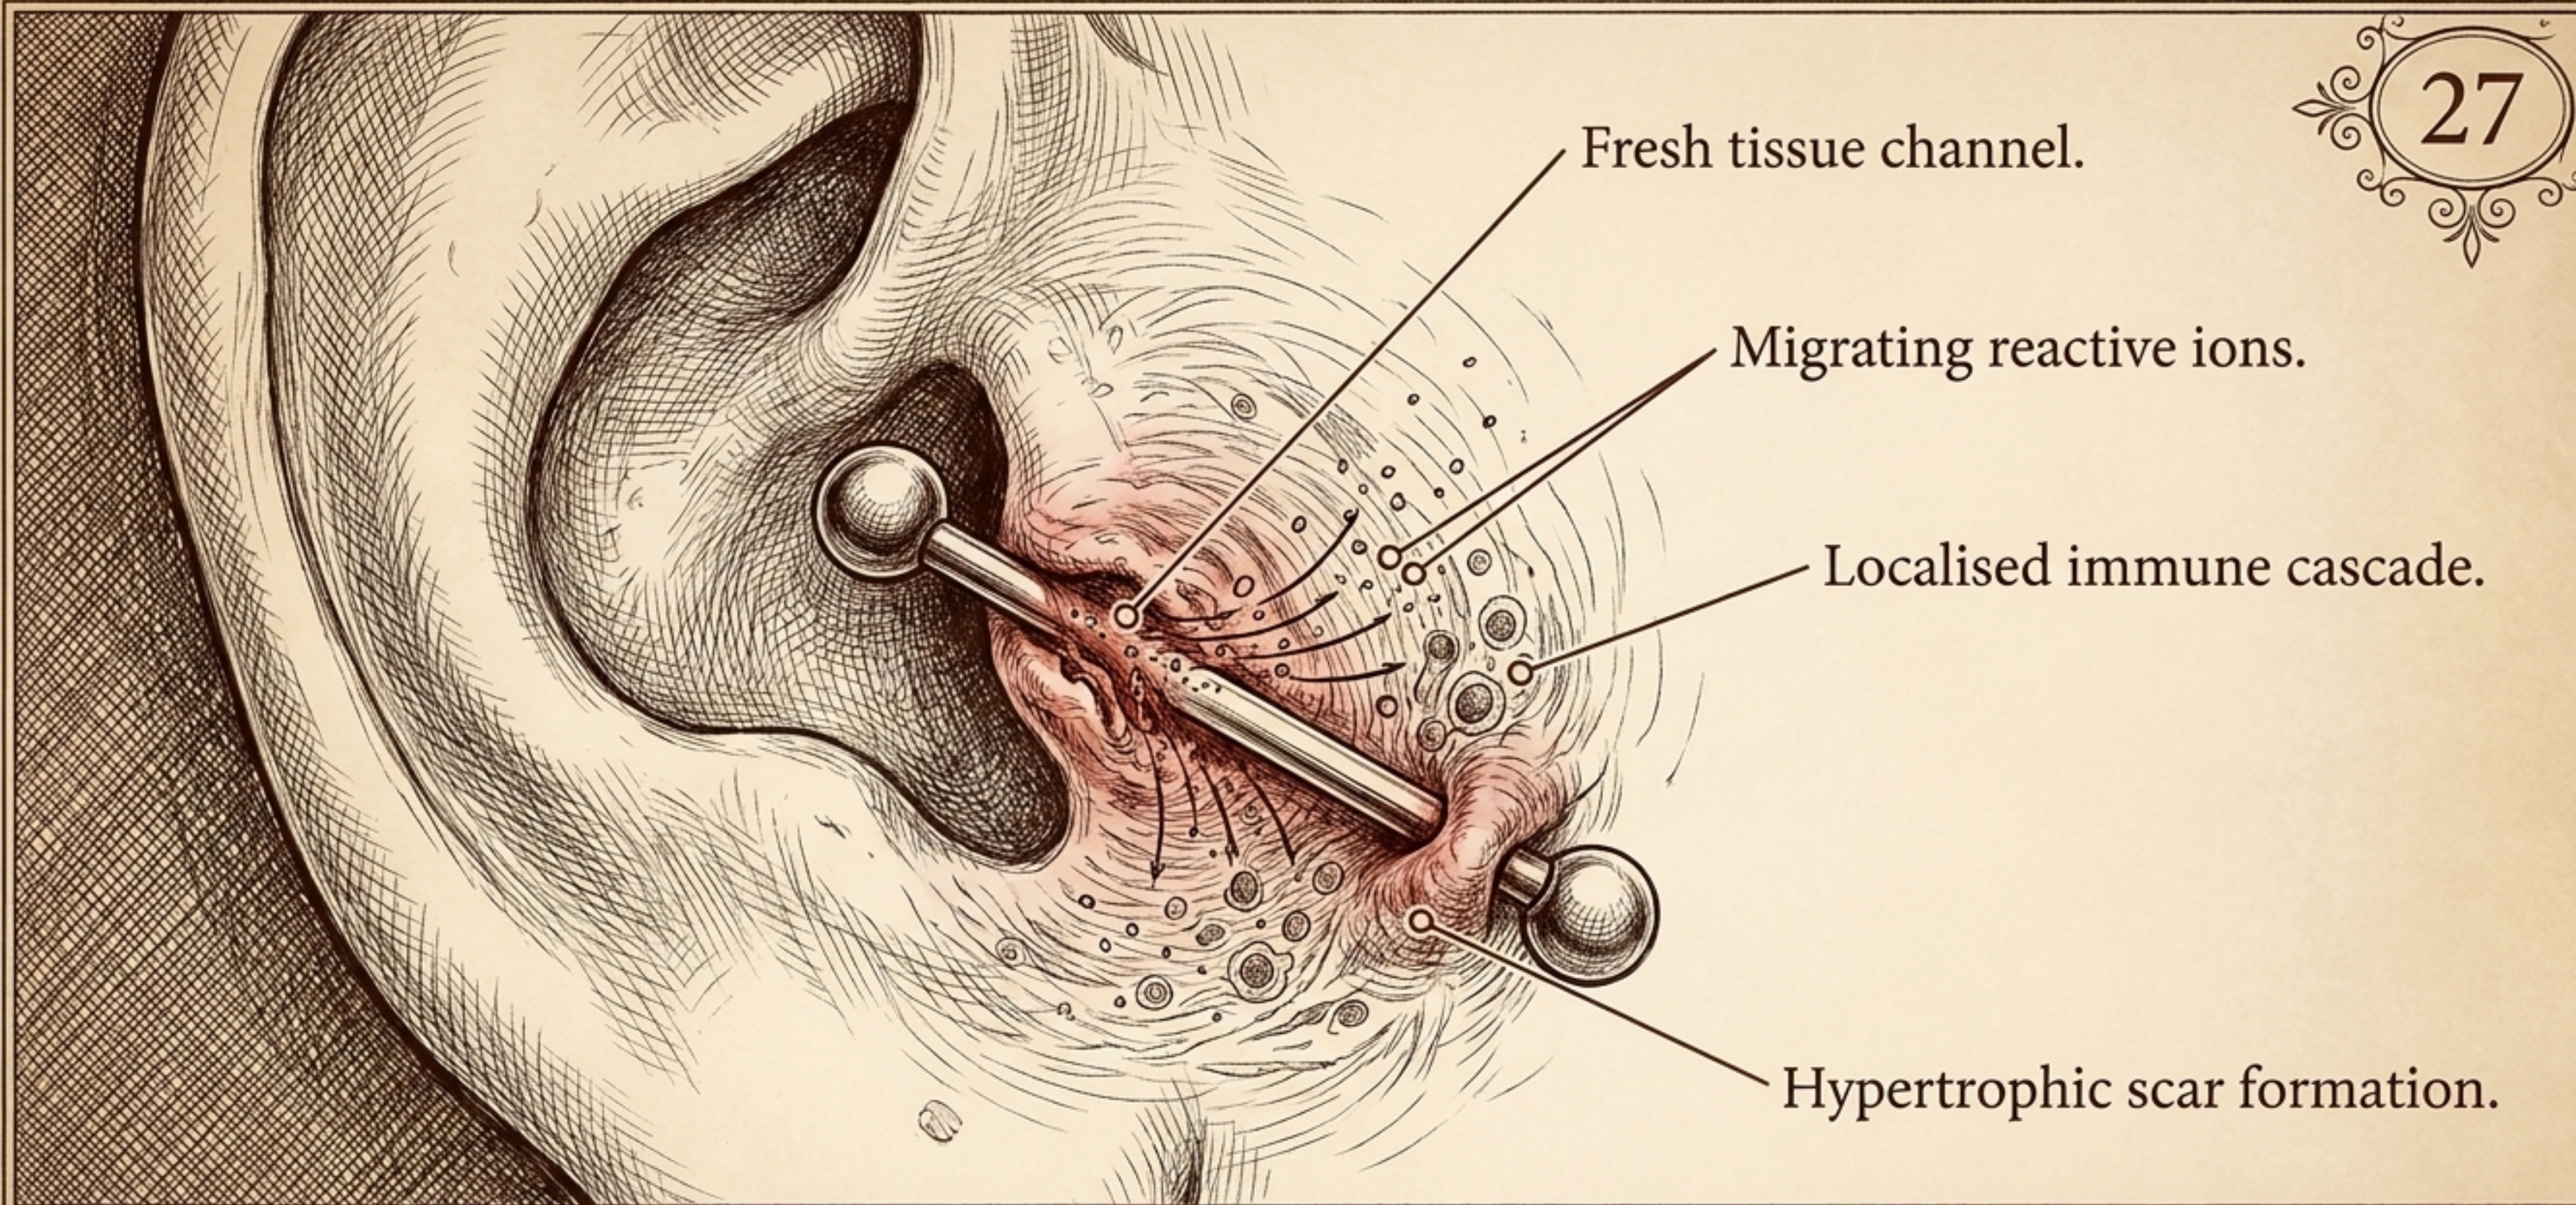

The safe release limit for fresh tissues is 0.5 micrograms.
Plated jewellery exceeds safe thresholds.