


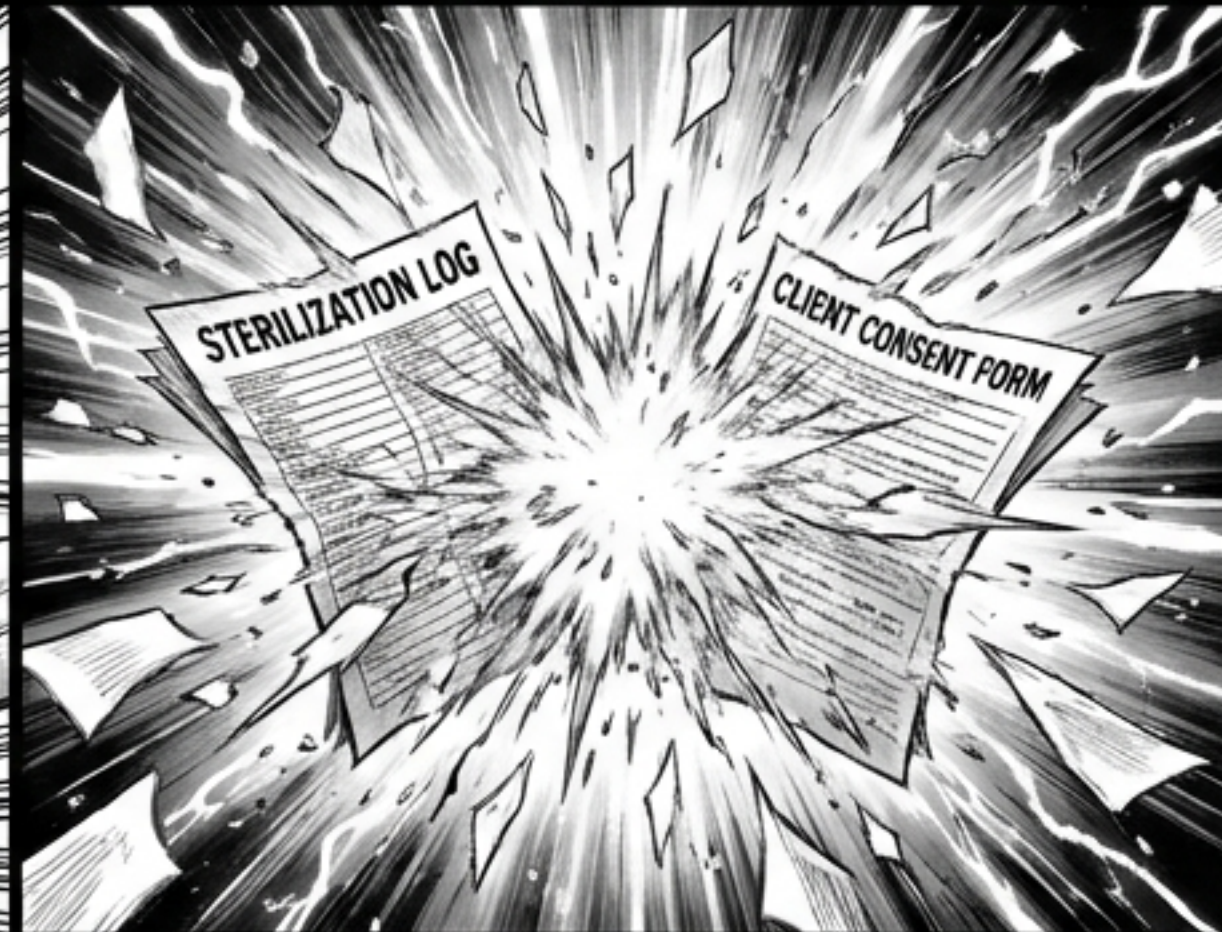

Inspection findings occur when sterilization logs and client consent records fail to connect.

Shockwaves of compliance often knock over the sterilization equipment.