
Implant-grade titanium eliminates contact allergen risk.

Unspecified surgical steel lacks regulatory definition.

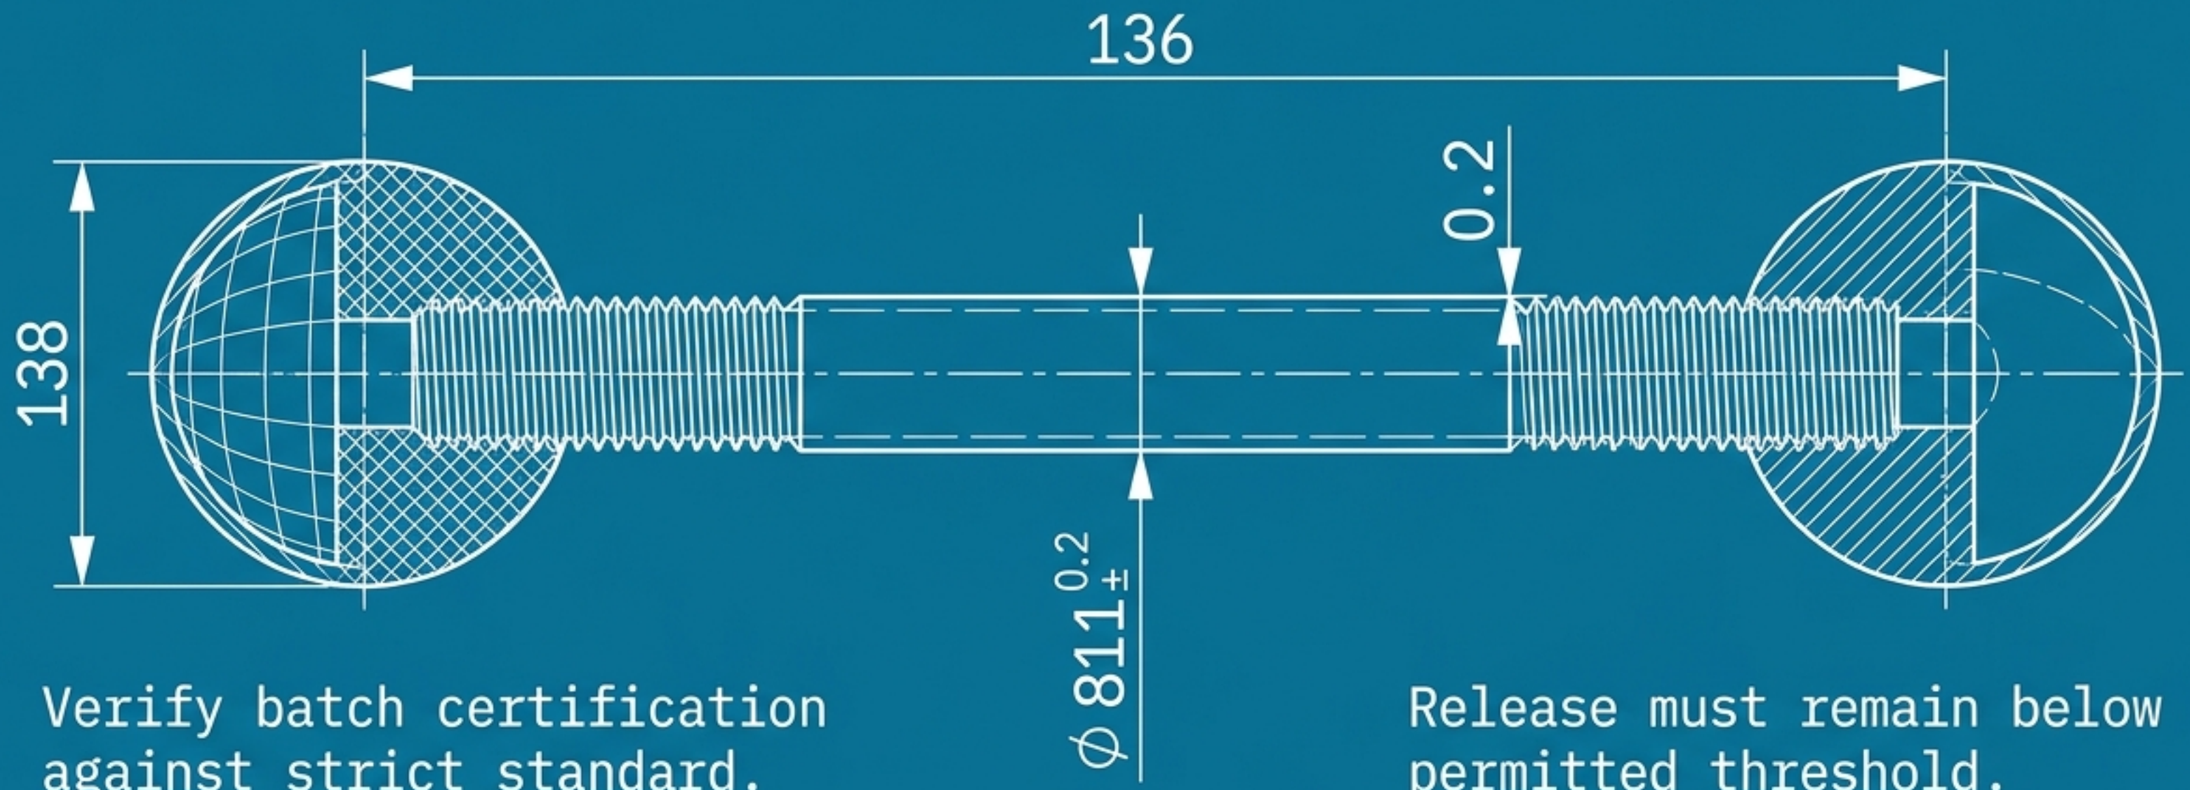

Verify batch certification against strict standard.

Release must remain below permitted threshold.

Compliance requires checking material certification thoroughly.

Trace jewellery to a mill certificate.