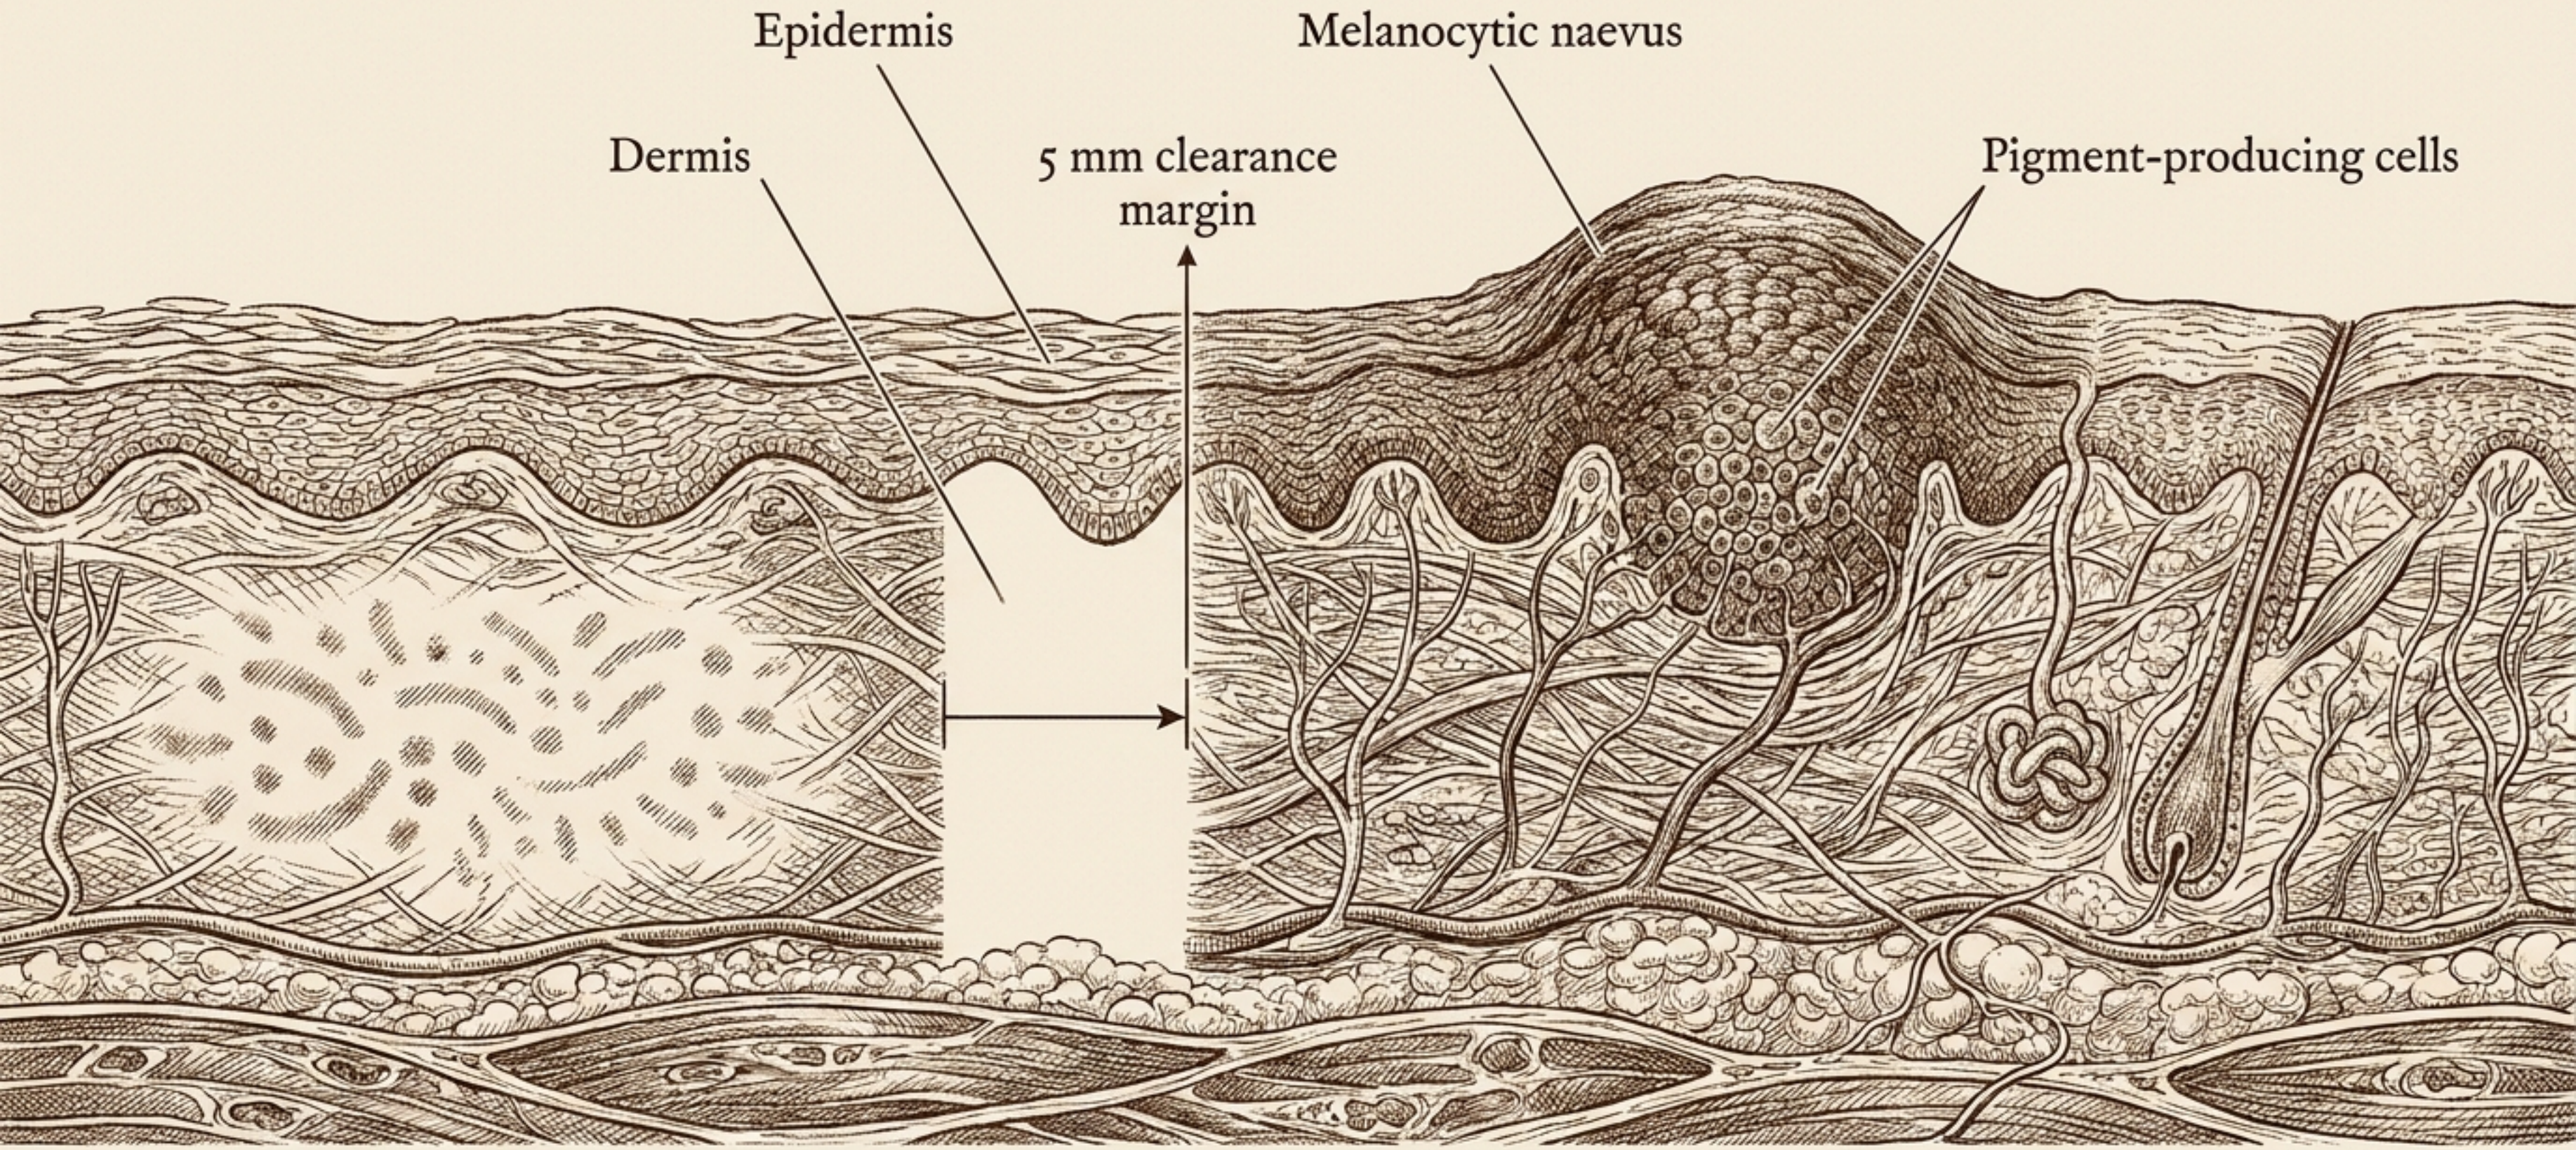


The clinical consensus recommends a minimum clearance margin of 5 mm around any mole.

MAINTAIN SAFE CLEARANCE MARGINS